


TENANT PROTECTION PLAN AND SAFETY NOTES

1. CONSTRUCTION OPERATION SHALL BE CONFINED TO THE AFFECTED APARTMENT/STORE INTERIOR AS MUCH AS POSSIBLE AND SHALL NOT CREATE DUST, DIRT, OR OTHER SUCH INCONVENIENCES TO OTHER APARTMENT UNITS WITHIN THE BUILDING.
2. CONSTRUCTION OPERATION SHALL NOT BLOCK HALLWAYS OR MEANS OR EGRESS FOR TENANTS OF THE BUILDING.
3. CONSTRUCTION OPERATION SHALL NOT INVOLVE INTERRUPTION OF HEATING, WATER, OR ELECTRICAL SERVICES TO TENANTS OF THE BUILDING.
4. CONSTRUCTION OPERATION SHALL BE CONFINED TO NORMAL WORKING HOURS 8AM TO 5PM, MONDAY THROUGH FRIDAY, EXCEPT LEGAL HOLIDAYS.
5. THE APARTMENT/STORE TO BE RENOVATED SHALL NOT BE OCCUPIED DURING THE COURSE OF CONSTRUCTION WORK.
6. INSTALLATION SHALL COMPLY WITH THE 2015 INTERNATIONAL MECHANICAL CODE AND THE 2016 UNIFORM CODE SUPPLEMENT.

GENERAL DRAWING NOTES

1. PULL STATION SHALL BE LOCATED APPROXIMATELY 48" ABOVE THE FINISHED FLOOR.
2. DISCHARGE FROM THE EXHAUST FAN SHALL BE AT A MINIMUM OF 40" ABOVE THE ROOF LINE.
3. WELDS SHALL BE INSPECTED PRIOR TO INSULATION.
4. ALL FAN SWITCHES SHALL BE LOCATED IN THE KITCHEN AREA.
5. ALL ELECTRICAL WIRING CONDUIT AND CONTROLS BY OTHERS.
6. EXHAUST FAN SHALL BE LOCATED AT LEAST 10' AWAY FROM BOTH THE PROPERTY LINE AND MAKE UP AIR UNIT.
7. EXHAUST FAN SHALL RUN DURING ALL COOKING PERIODS. HOOD FILTERS SHALL BE IN PLACE.

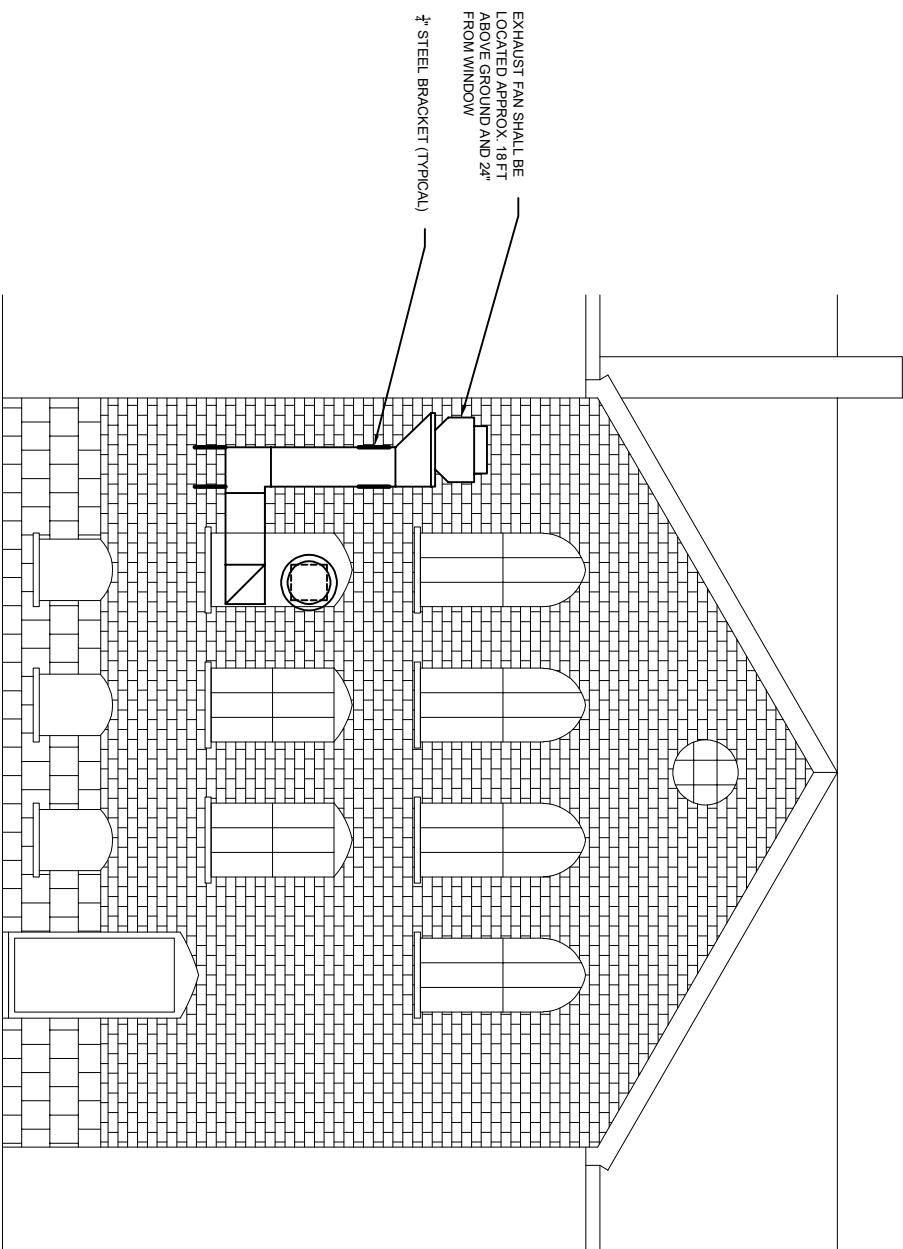

IDEAL FIRE PROTECTION INC.
60 NORTH HARRISON AVENUE
CONGERS, NY 10520
PHONE: 845-629-3550

PROFESSIONAL SEAL

REVISION HISTORY

NO.	DATE

BUILDING ELEVATION

CLIENT

THE ANGELS NYACK

18 SOUTH BROADWAY
NYACK, NY 10560

DRAWN BY	D.K.
CHECKED BY	J.K.
DATE DRAWN	6/14/2025
SHEET NO.	2 OF 2